

## SIGNIFICANCE OF SHUNT ACTIVE POWER FILTERS USING MATLAB/SIMULINK IN IMPROVING QUALITY OF POWER

**K. KUSAL KUMAR**

Research Scholar  
Shri Jagadishprasad Jhabarmal Tibrewala  
university(JJTU)  
Rajasthan, India  
[kushal.442@gmail.com](mailto:kushal.442@gmail.com)

**Dr. DARAPUREDDI VIJAYA KUMAR**

Dept. of Electrical and Electronics Engineering  
AITAM, Tekkali  
Visakhapatnam, India  
[drdvk2010@gmail.com](mailto:drdvk2010@gmail.com)

### **Abstract:**

*Along with the increasing demand on improving power quality i.e generally defined as any change in power (voltage, current, or frequency) that interferes with the normal operation of electrical equipment, the most popular technique that has been used is Active Power Filter (APF); This is because Passive filters performance is limited to a few harmonics and they can introduce resonance in the power system. Passive filters are larger component sizes and therefore Costs high. So APF can easily eliminate unwanted harmonics, improve power factor and overcome voltage sags and eliminate any harmonic frequencies. This paper will discuss and analyze the simulation result for a three-phase three wire shunt active power filter using MATLAB program. This simulation will implement a non-linear load, to compensate line current harmonics under balanced and unbalance loads. As a result of the simulation, it is found that an active power filter is the better way to reduce the total harmonic distortion (THD). Improvement of Power quality is major concern in the field of power supply. Various methods have been adapted towards the improvement of power quality. Trend of improving it by using active power filter has been increased in recent years because of its simplicity. In this paper we have used the p-q reference theory as controller to control the output of active power filter to delete the harmonics and to compensate the power factor, PI controller is used to maintain almost constant value under transient and steady state condition. The harmonics occurred due to non linear load which draw current in abrupt manner rather than smooth way leads to create distorted signal on source side on the line which affect the other customers on the same line.*


**Keywords:** APF, PWM converter, THD, Power Quality.

### **1.0 INTRODUCTION:**

A harmonic is a component of a periodic wave having a frequency that is an integral multiple of the fundamental power line frequency of 60 Hz. Harmonics are the multiple of the fundamental frequency. Total harmonic distortion is the contribution of all the harmonic frequency currents to the fundamental. Decade ago most of the device used are linear and passive in nature have less number of non linear load leads to less impact on the quality of supplied power but In last few years the trend has been changed the electronics equipment has been taken Place a very important role in our day to day life whether it is our household mobile adapter, computer, inverter, refrigerator or commercial fax machine, Xerox machine, printer, PLC's, power electronic convertor device or other various non –linear devices, With addition to that various power electronic devices like convertors are used (in adjustable speed drives, switch mode power supplies, etc.) to increase the efficiencies and power factor of wind, solar, and other non-conventional sources to improve the efficiency and ability of system. Active filters has the less weights and size ,no loading problem and cheaper due to absence of heavy and costly inductors and handling harmonics varies between the specific frequencies. and produce a non-linear voltage drop ( $\Delta v$ ) in

the line impedance, which distorts the load voltage (vL).

Harmonics are the by-products of modern electronics. They occur frequently when there are large numbers of personal computers (single phase loads), uninterruptible power supplies (UPSs), variable frequency drives (AC and DC) or any electronic device using solid state power switching supplies to convert incoming AC to DC. Non-linear loads create harmonics by drawing current in abrupt short pulses, rather than in a smooth sinusoidal manner

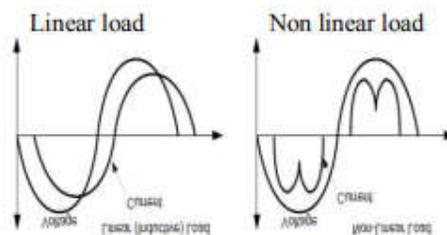

The terms “linear” and “non-linear” define the relationship of current to the voltage waveform. A linear relationship exists between the voltage and current, which is typical of an across-the-line load. A non-linear load has a discontinuous current relationship that does not correspond to the applied voltage waveform.

$h = (n \times p) \pm 1$  where:  $n =$  an integer (1, 2, 3, 4, 5...)

$p =$  number of pulses or rectifiers.

For example, using a 6 pulse rectifier, the characteristic harmonics will be:

$h = (1 \times 6) \pm 1$  5th & 7th harmonics

$h = (2 \times 6) \pm 1$  11th & 13th harmonics

$h = (3 \times 6) \pm 1$  17th & 19th harmonics

Harmonic is defined as “a sinusoidal component of a periodic wave or quantity having a frequency that is an integral multiple of the fundamental frequency”.

### SHUNT ACTIVE FILTERS:

Nowadays, a shunt active filter is not a dream but a reality, and many shunt active

filters are in commercial operation all over the world. Their controllers determine in real time the compensating current reference, and force a power converter to synthesize it accurately. In this way, the active filtering can be selective and adaptive. In other words, a shunt active filter can compensate only for the harmonic current of a selected nonlinear load, and can continuously track changes in its harmonic content. The shunt active power filter, with a self-controlled dc bus, has a topology similar to that of a static compensator (STATCOM) used for reactive power compensation in power transmission systems. Shunt active power filters compensate load current harmonics by injecting equal but opposite harmonic compensating current. In this case the shunt active power filter operates as a current source injecting the harmonic components generated by the load but phase shifted by 180°.


They are two categories of active filter such as single phase and three-phase. Three-phase active filters may be with or without neutral connection and single phase active filters are used to compensate power quality problems caused by single-phase loads such as DC power supplies. Three-phase active filters are used for high power nonlinear loads such as adjustable speed drive (ASD) and AC to DC converters. Based on topologies, they are two kinds of active filters such as current source and voltage source active filters. Current source active filters (CSAF) employ an inductor as the DC energy storage device as shows in Fig. 1. In voltage source active filter (VSAF), a capacitor acts as the storage element. VSAF are inexpensive, lighter, and easier to control compare to CSAF. There are types of connection that can be used for

active filter such as shunt active filter, series active filter, parallel active filter.


**Harmonic currents are generated mainly due to the presence of:**

**Nonlinear loads:**


Harmonic voltages in the power system: A nonlinear load draws a fundamental current component  $I_{LF}$  and a harmonic current  $I_{Lh}$  from the power system. The harmonic current  $I_{Sh}$ , is induced by the source harmonic voltage  $V_{Sh}$ . A shunt active filter can compensate both harmonic currents  $I_{Sh}$  and  $I_{Lh}$ , however the principal function of a shunt active filter is compensation of the load harmonic current  $I_{Lh}$ , this means that the active filter confines the load harmonic current at the load terminals, hindering its penetration into the power system. For simplicity the power system is represented only by an equivalent impedance  $X_L$  in Fig.1. If the load harmonic current  $I_{Lh}$ , flows through the power system, it produces an additional harmonic voltage drop equal to  $V_T = X_L * I_{Lh}$ , that further degenerates the load terminal voltage  $V_T$ . The principle of shunt current compensation shown in Fig.4.1 is very effective in compensating harmonic currents of loads. However, a shunt active filter that realizes this principle of shunt current compensation should also draw an additional harmonic current in order to keep the load terminal voltage sinusoidal and equal to  $V_T = V_{SF} - X_L * I_{LF}$ . The harmonic voltage drop appearing across the equivalent impedance becomes equal to the source harmonic voltage if  $V_{Sh} = X_L * I_{Sh}$ . In this case, the harmonic voltage components cancel each other, so that the terminal voltage  $V_T$ , is kept sinusoidal.

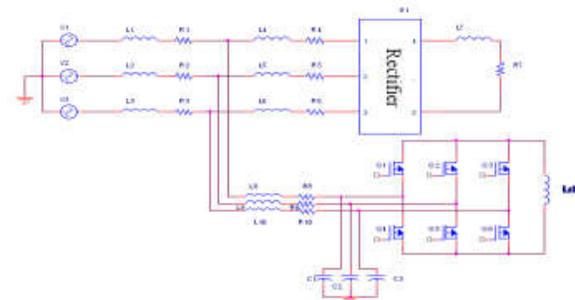

**Fig. 1: A typical three-phase current source active filter (CSAF)**

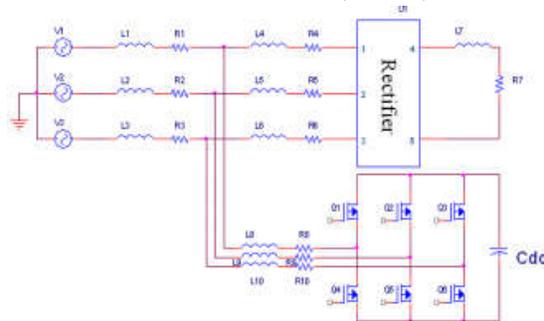

**Fig.2: A typical three-phase voltage source (VSAF)**

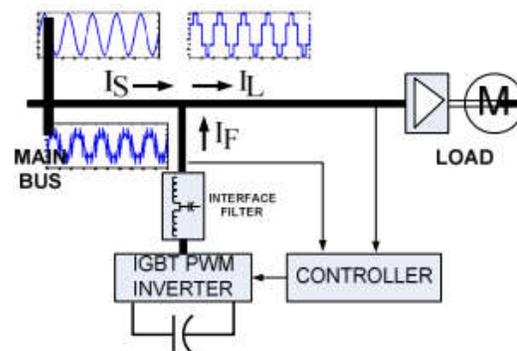

**Fig.3. Diagram illustrating component of shunt connected active filter with the waveform show**

**2.0 LITERATURE REVIEW:**

**JenoPaul P, (2011)** The smaller Total Harmonic distortion the harmonic pollution in the power system will be reduced and the power quality will be increased. The proposed approach has been tested and validated on the matrix converter using Matlab/Simulink .The Simulation results are shown to

demonstrate the advantages of the proposed scheme.

**IRFAN ALI, (2016)** The aim of this work is to design shunt active filter to mitigate and alleviate the harmonics and reactive power issues with controller based on different theories under unbalanced and distorted regimes. In this paper a control method for active power filter using Space Vector Pulse Width Modulation (SVPWM) is compared with other control techniques.


**Aizad Khursheed, (2017)** This paper presents the performance of Shunt Hybrid Active Power Filter (SHAPF) for power quality improvement in terms of harmonics and reactive power compensation, and power factor improvement in the distribution network caused by nonlinear load. In the proposed control method, the compensation process is based on sensing of source currents only.

**3.0 METHODOLOGY:**

**PROPOSED CONTROL STRATEGY:**

The p-q theory in Three-Phase, Three-Wire System:

This concept is very popular and, basically consists of a variable transformation from a, b, c, reference frame of the instantaneous power, voltage, and current signals to the  $\alpha$ ,  $\beta$  reference frame. The transformation equations from the a, b, c, reference frame to the  $\alpha$ ,  $\beta$ , 0 coordinates can be derived from the phasor diagram shown in Fig.4

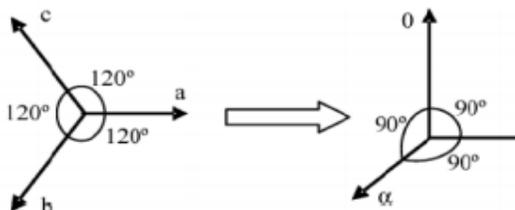

**Figure 4: Transformation from the phase reference system(a, b, c) to ( $\alpha$ ,  $\beta$ , 0) system**

The instantaneous values of voltages and currents in the  $\alpha$ ,  $\beta$  coordinates can be obtained from the following equations, the Clarke transformation and inverse Clarke transformation of three phase generic voltage given by, Similarly three phase generic instantaneous line currents  $i_a, i_b, i_c$  can be transform on the  $\alpha\beta$  axis by This transformation is valid if and only if  $V_a(t)+V_b(t)+V_c(t)$  is equal to zero, and also if the voltages are balanced and sinusoidal. The instantaneous active and reactive power in the  $\alpha\beta$  coordinates are calculated with the following expressions The instantaneous complex power is possible using the instantaneous vectors of voltage and current. The instantaneous complex power is defined as the product of the voltage  $V$  and the conjugate of the current vector  $i^*$ , given in the form of complex numbers.

**INSTANTNEOUS POWER THEORY:**

$$S=V \cdot i^* = (v_\alpha+jv_\beta) \cdot (i_\alpha-j i_\beta) = (v_\alpha i_\alpha+ v_\beta i_\beta)+j(v_\beta i_\alpha- v_\alpha i_\beta)$$

From this active and reactive power components are

$$p = v_\alpha i_\alpha+ v_\beta i_\beta$$

$$q = v_\alpha i_\beta - v_\beta i_\alpha$$

For systems that do not have a neutral connection, the z ero sequence does not exist and the mathematical equation will be presented in matrix form

$$\begin{bmatrix} V_\alpha \\ V_\beta \end{bmatrix} = \sqrt{\frac{2}{3}} \begin{bmatrix} 1 & -\frac{1}{2} & -\frac{1}{2} \\ 0 & \frac{\sqrt{3}}{2} & -\frac{\sqrt{3}}{2} \end{bmatrix} \begin{bmatrix} V_a \\ V_b \\ V_c \end{bmatrix}$$

And

$$\begin{bmatrix} i_\alpha \\ i_\beta \end{bmatrix} = \sqrt{\frac{2}{3}} \begin{bmatrix} 1 & -\frac{1}{2} & -\frac{1}{2} \\ 0 & \frac{\sqrt{3}}{2} & -\frac{\sqrt{3}}{2} \end{bmatrix} \begin{bmatrix} i_a \\ i_b \\ i_c \end{bmatrix}$$

From this active and reactive components are

$$p = v_\alpha i_\alpha + v_\beta i_\beta$$

$$q = v_\alpha i_\beta - v_\beta i_\alpha$$

The active and reactive powers in matrix form is given below

$$\begin{bmatrix} p \\ q \end{bmatrix} = \begin{bmatrix} V_\alpha & V_\beta \\ -V_\beta & V_\alpha \end{bmatrix} \begin{bmatrix} i_\alpha \\ i_\beta \end{bmatrix}$$

Active and reactive powers can be separated into two parts which are AC part and DC part as shown below

$$\begin{aligned} p &= \bar{p} + \tilde{p} \\ q &= \bar{q} + \tilde{q} \end{aligned}$$

In order to get the DC part of the active and reactive power, the signals need to be filtered using low pass filter. The low-pass filter will remove the high frequency component and give the fundamental part.

Where  $\bar{p}$  is DC component of the instantaneous power  $p$  is related to the conventional fundamental active current.

$\tilde{p}$  is the ac component of the instantaneous power  $\tilde{p}$ , it does not have average value, and is related to the harmonic currents caused by the ac component of the instantaneous real power

$\bar{q}$  is the dc component of the imaginary instantaneous power  $q$ , and is related to the reactive power generated by the fundamental components of voltages and currents.  $\tilde{q}$  is the ac component of the instantaneous imaginary power  $q$ , and it is related to the harmonic currents caused by the ac component of instantaneous reactive power.

$$\begin{bmatrix} i_{Ca}^* \\ i_{Cb}^* \\ i_{Cc}^* \end{bmatrix} = \frac{1}{V_\alpha^2 + V_\beta^2} \begin{bmatrix} V_\alpha & V_\beta \\ V_\beta & -V_\alpha \end{bmatrix} \begin{bmatrix} -\bar{p} \\ -\bar{q} \end{bmatrix}$$

The final compensating currents components in a, b, c reference frame in terms of  $\alpha\beta$  given as

$$\begin{bmatrix} i_{Ca}^* \\ i_{Cb}^* \\ i_{Cc}^* \end{bmatrix} = \sqrt{\frac{2}{3}} \begin{bmatrix} 1 & -\frac{1}{2} & -\frac{1}{2} \\ 0 & \frac{\sqrt{3}}{2} & -\frac{\sqrt{3}}{2} \end{bmatrix} \begin{bmatrix} i_{Ca}^* \\ i_{Cb}^* \end{bmatrix}$$


These are the compensation current injected by the shunt active filter to reduce harmonics in three phase-three wire systems.

**4.0 SIMULATION RESULTS:**


**4.1 THREE PHASE SYSTEM FEEDING A NONLINEAR LOAD:**

The Below figure shows the line model of Three phase THREE WIRE system feeding Non-Linear load.

**4.1.1 without shunt active power filter:**

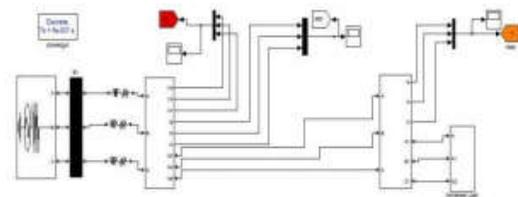


**NONLINEAR LOAD MODEL**

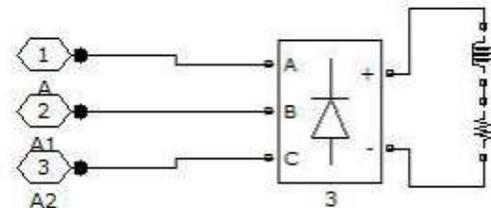


**Fig.5: Three Phase balanced Non-linear Load model**

**4.1.2 OUTPUT WAVE FORMS WITHOUT SHUNT ACTIVE FILTER FOR THREE PHASE BALANCED LOAD**

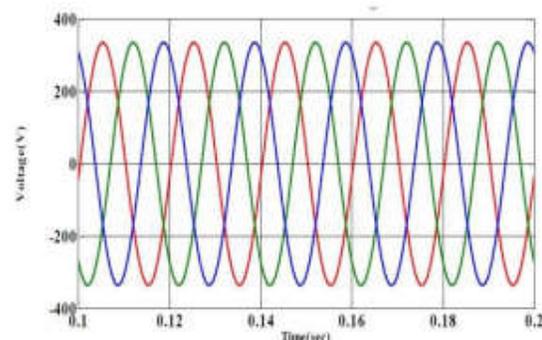


**(a)**

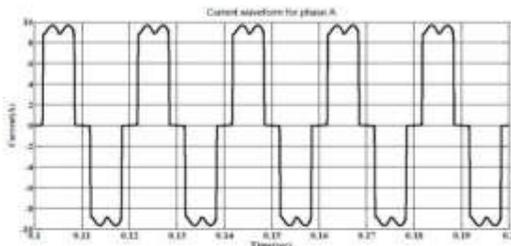

**(b)**  
**Fig.6: Waveform of (a) Three Phase voltage (b) Line Current without shunt active filter for phase A**

When the nonlinear load consists of an uncontrolled three phase rectifier with an inductance of 30 mH and a 60Ω resistor connected in series on the dc side shows in “Fig.6”. The line and load current wave forms as shown above. The magnitude of the distorted line current for phase -A is 10.26A and Total Harmonic Distortion of the Phase load current is 29.53%.


**4.1.3 THD ANALYSIS: For Balanced Nonlinear Load:**

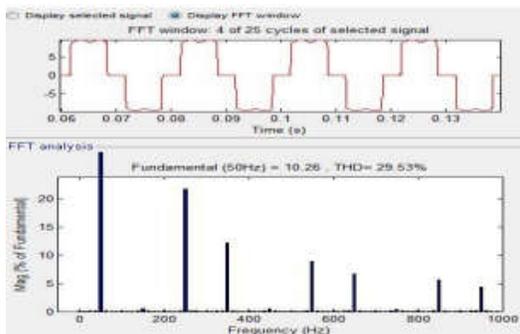

**Fig.7: FFT Analysis for Phase-A Line Current without APF**

**4.2 With a shunt active filter:**


Three Phase-Three wire System a Non-Linear Load with Shunt Active Power Filter

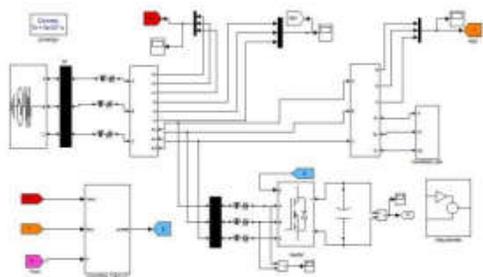


**Fig.8: Three Phase System Feeding a Non-linear Load with Shunt Active Power Filter**

The power circuit is a three-phase system supplied by a sinusoidal balanced three-phase 415V source with a source inductance of 1 mH and a source resistance of 0.1Ω . The inverter consists of an Insulated Gate Bipolar Transistor (IGBT) bridge. On the dc side, 1500μF capacitor is connected.


**5.0 OUTPUT WAVE FORMS:**

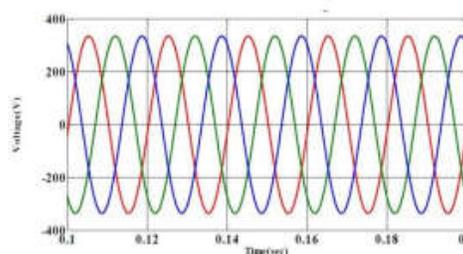

**(a)**

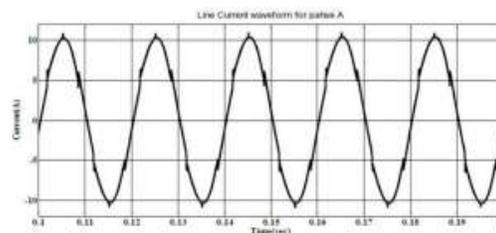


**(b)**

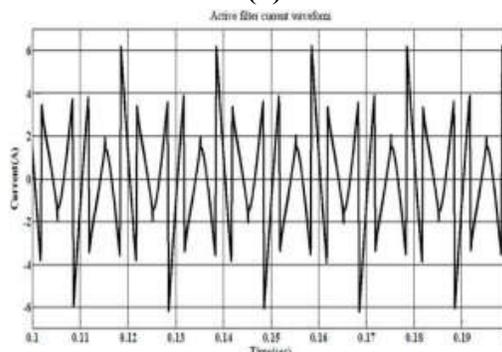

**(c)**

Waveforms of  
 (a) Three Phase Line Voltage  
 (b) Line Current for phase A  
 (c) Harmonic current with shunt active filter for phase A

**FFT ANALYSIS: For Phase-A Line Current with shunt active filter:**

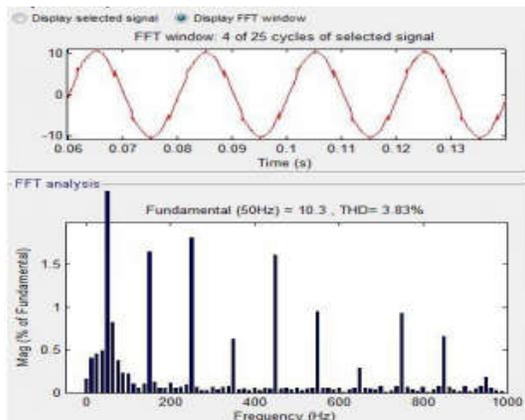


**Figure 9: FFT Analysis for Phase-A Line Current with shunt active Filter**


When we connect a nonlinear balanced load to the system the line and load current wave forms after compensation i.e after connecting shunt active filter as shown above. The magnitude of the line current for phase -A is 10.3A and Total Harmonic Distortion of the Phase line current is 3.83%.

**5.1 OUTPUT WAVE FORMS WITH AND WITHOUT SHUNT ACTIVE FILTER FOR THREE PHASE UNBALANCED LOAD**


In this case, the three-phase load is built with three single phase uncontrolled rectifiers with inductors and resistors connected in series at the dc side with the values of a, b and c phase are “80, 3mH” and “70Ω, 300mH” and “30Ω, 30mH”.

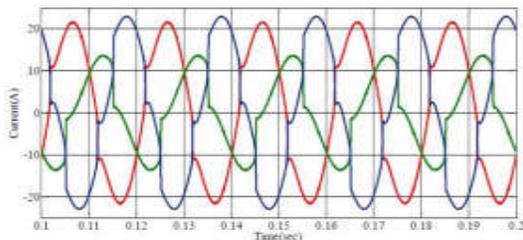

**Fig 10: Wave forms of Three Phase Line Current without shunt active filter**

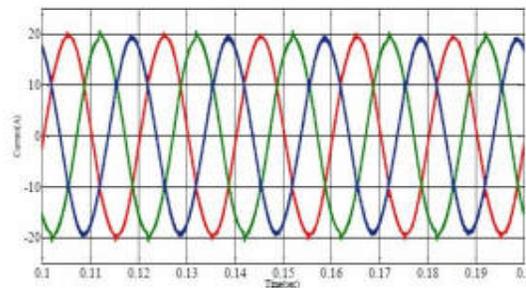

**5.1.2. (a)**

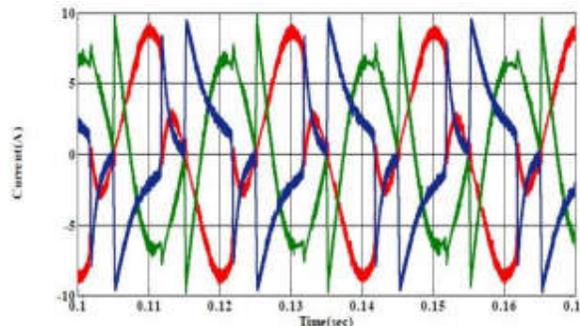


**5.1.2. (b)**

**5.1.2 Waveforms are**


- (a) Three Phase Line Current with shunt active filter
- (b) Harmonic current with shunt active Filter

**THD ANALYSIS:**

For Unbalanced Nonlinear Load without active filter

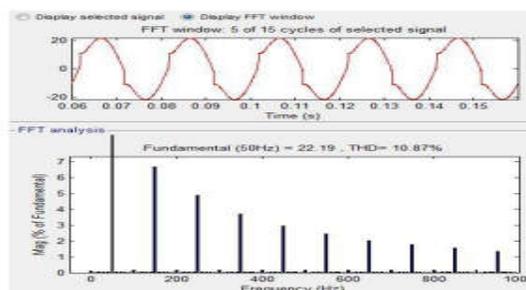


**(a)**

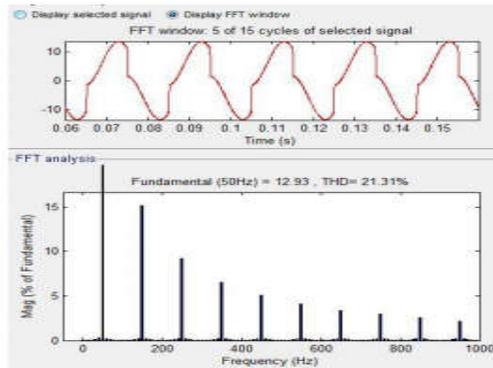


**Fig.11: FFT Analysis for (a) Phase-A Line Current (b) for Phase-B Line Current**

### THD ANALYSIS: For Unbalanced Nonlinear Load with active filter

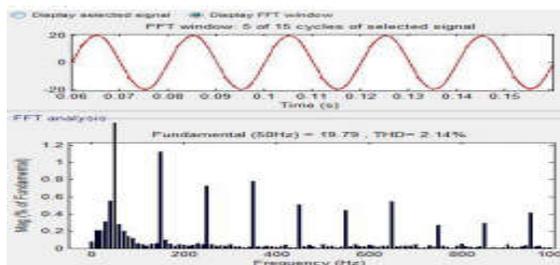

(a)

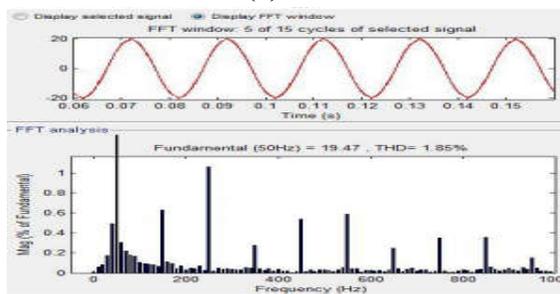

(b)

**Fig 12: FFT Analysis for (a) Phase-A Line Current (b) for Phase-B Line Current**

When we connect a nonlinear unbalanced load to the system, before compensation i.e without active filter the line and load current magnitudes of the phase A, phase B, phase C are 22.19A,12.93A,23.2A and Total Harmonic Distortion of line currents of Phases A,B,C are 10.87%,21.31%,13.87%. After compensation i.e with shunt active filter the line current magnitudes of the phase A,

phase B, phase C are 19.79A,19.47A,19.01A and Total Harmonic Distortion of line currents of Phases A,B,C are 2.14%,1.85%,1.85%.

### 6.0 Conclusion:

Power quality management is the main problem that the industry is facing today. This is mainly affected by the generation of harmonics. The growing use of electronic equipment produces a large amount of harmonics in distribution systems because of non-sinusoidal currents consumed by non-linear loads. The system of Shunt Active Power Filter is proposed in this work. Conventional way of harmonics elimination by using passive filter might suffer from parasitic problem. It has been shown that three phase active filter based on p-q theory can be implemented for harmonic mitigation and power factor correction. Harmonics mitigation carried out by the active filter was showed In this project and we clearly calculate the Total Harmonic distortion(THD) with active filters and without active filters.

### References:

1. Emilio F. Couto, Julio S. Martins, Joao L. Afonso, —Simulation Result of a Shunt Active filter with control based on p-q Theory., ICREPQ International Conference on renewable energies and power quality Vigo, Espanha, 9-12 de abril de 2003, paper 394, ISBN: 846076768x
2. Emilio F. Couto, Julio S. Martins, Joao L. Afonso, —Shunt active filter for power quality improvement. international conference UIE 2000-Electricity for sustainable Urban Development Lisboa ,Portugal 1-4 nov 2000, pp 683-691.
3. H. Akagi, New trends in active filters for power conditioning, *IEEE Trans. Ind. Appl.* 32 (1996) 1312–1322.
4. J. Afonso, et al., Active filters with control based on the p-q theory, *IEEE Ind. Electron. Soc. Newsletter* 47 (3) (2000) 5–11.

5. *Murat kale,Engin Ozdemir —An adaptive hysteresis band current controller for shunt active power filter. Electric power system research 73(2005)113-119.*
6. *Murat kale,Engin Ozdemir —Harmonic and reactive power compensation with shunt active power filter under non-ideal mains voltage, Electric power system research 74(2005) 363-370.*
7. *S. Lofli and M. Sajedi\* Role of a Shunt Active Filter in Power Quality Improvement and Power Factor Correction J. Basic. Appl. Sci. Res., 2(2)1015-1020, 2012 © 2012, Text Road Publication ISSN 2090-4304 Journal of Basic and Applied.*
8. *Parag Kanjiya, Vinod Khadkikar and Hatem H. Zeineldin “A non-iterative optimized algorithm for shunt active power filter under distorted and unbalanced power supply” IEEE transaction on industrial electronics, 2011.*
9. *Sakshi Bangia, P R Sharma, Maneesha Garg“Simulation of Fuzzy Logic Based Shunt Hybrid Active Filter for Power Quality Improvement” MECS, I.J. Intelligent Systems and Applications, vol 02, 2013, pp 96-104.*
10. *S.K. Jain, P. Agrawal and H.O. Gupta “Fuzzy logic controlled shunt active power filter for power quality improvement” IEEE on Electric Power Applications, IEE Proceedings, vol149, Issue:5, 2002 , pp 317 – 328.*
11. *Rajanidevi Gajula, Power Quality Improvement With A Shunt Active Power Filter Using 3-Control Strategies, Anveshana’s International Journal Of Research In Engineering And Applied Sciences, Volume 2, Issue 10 (2017, October)(Issn-2455-6300)*